


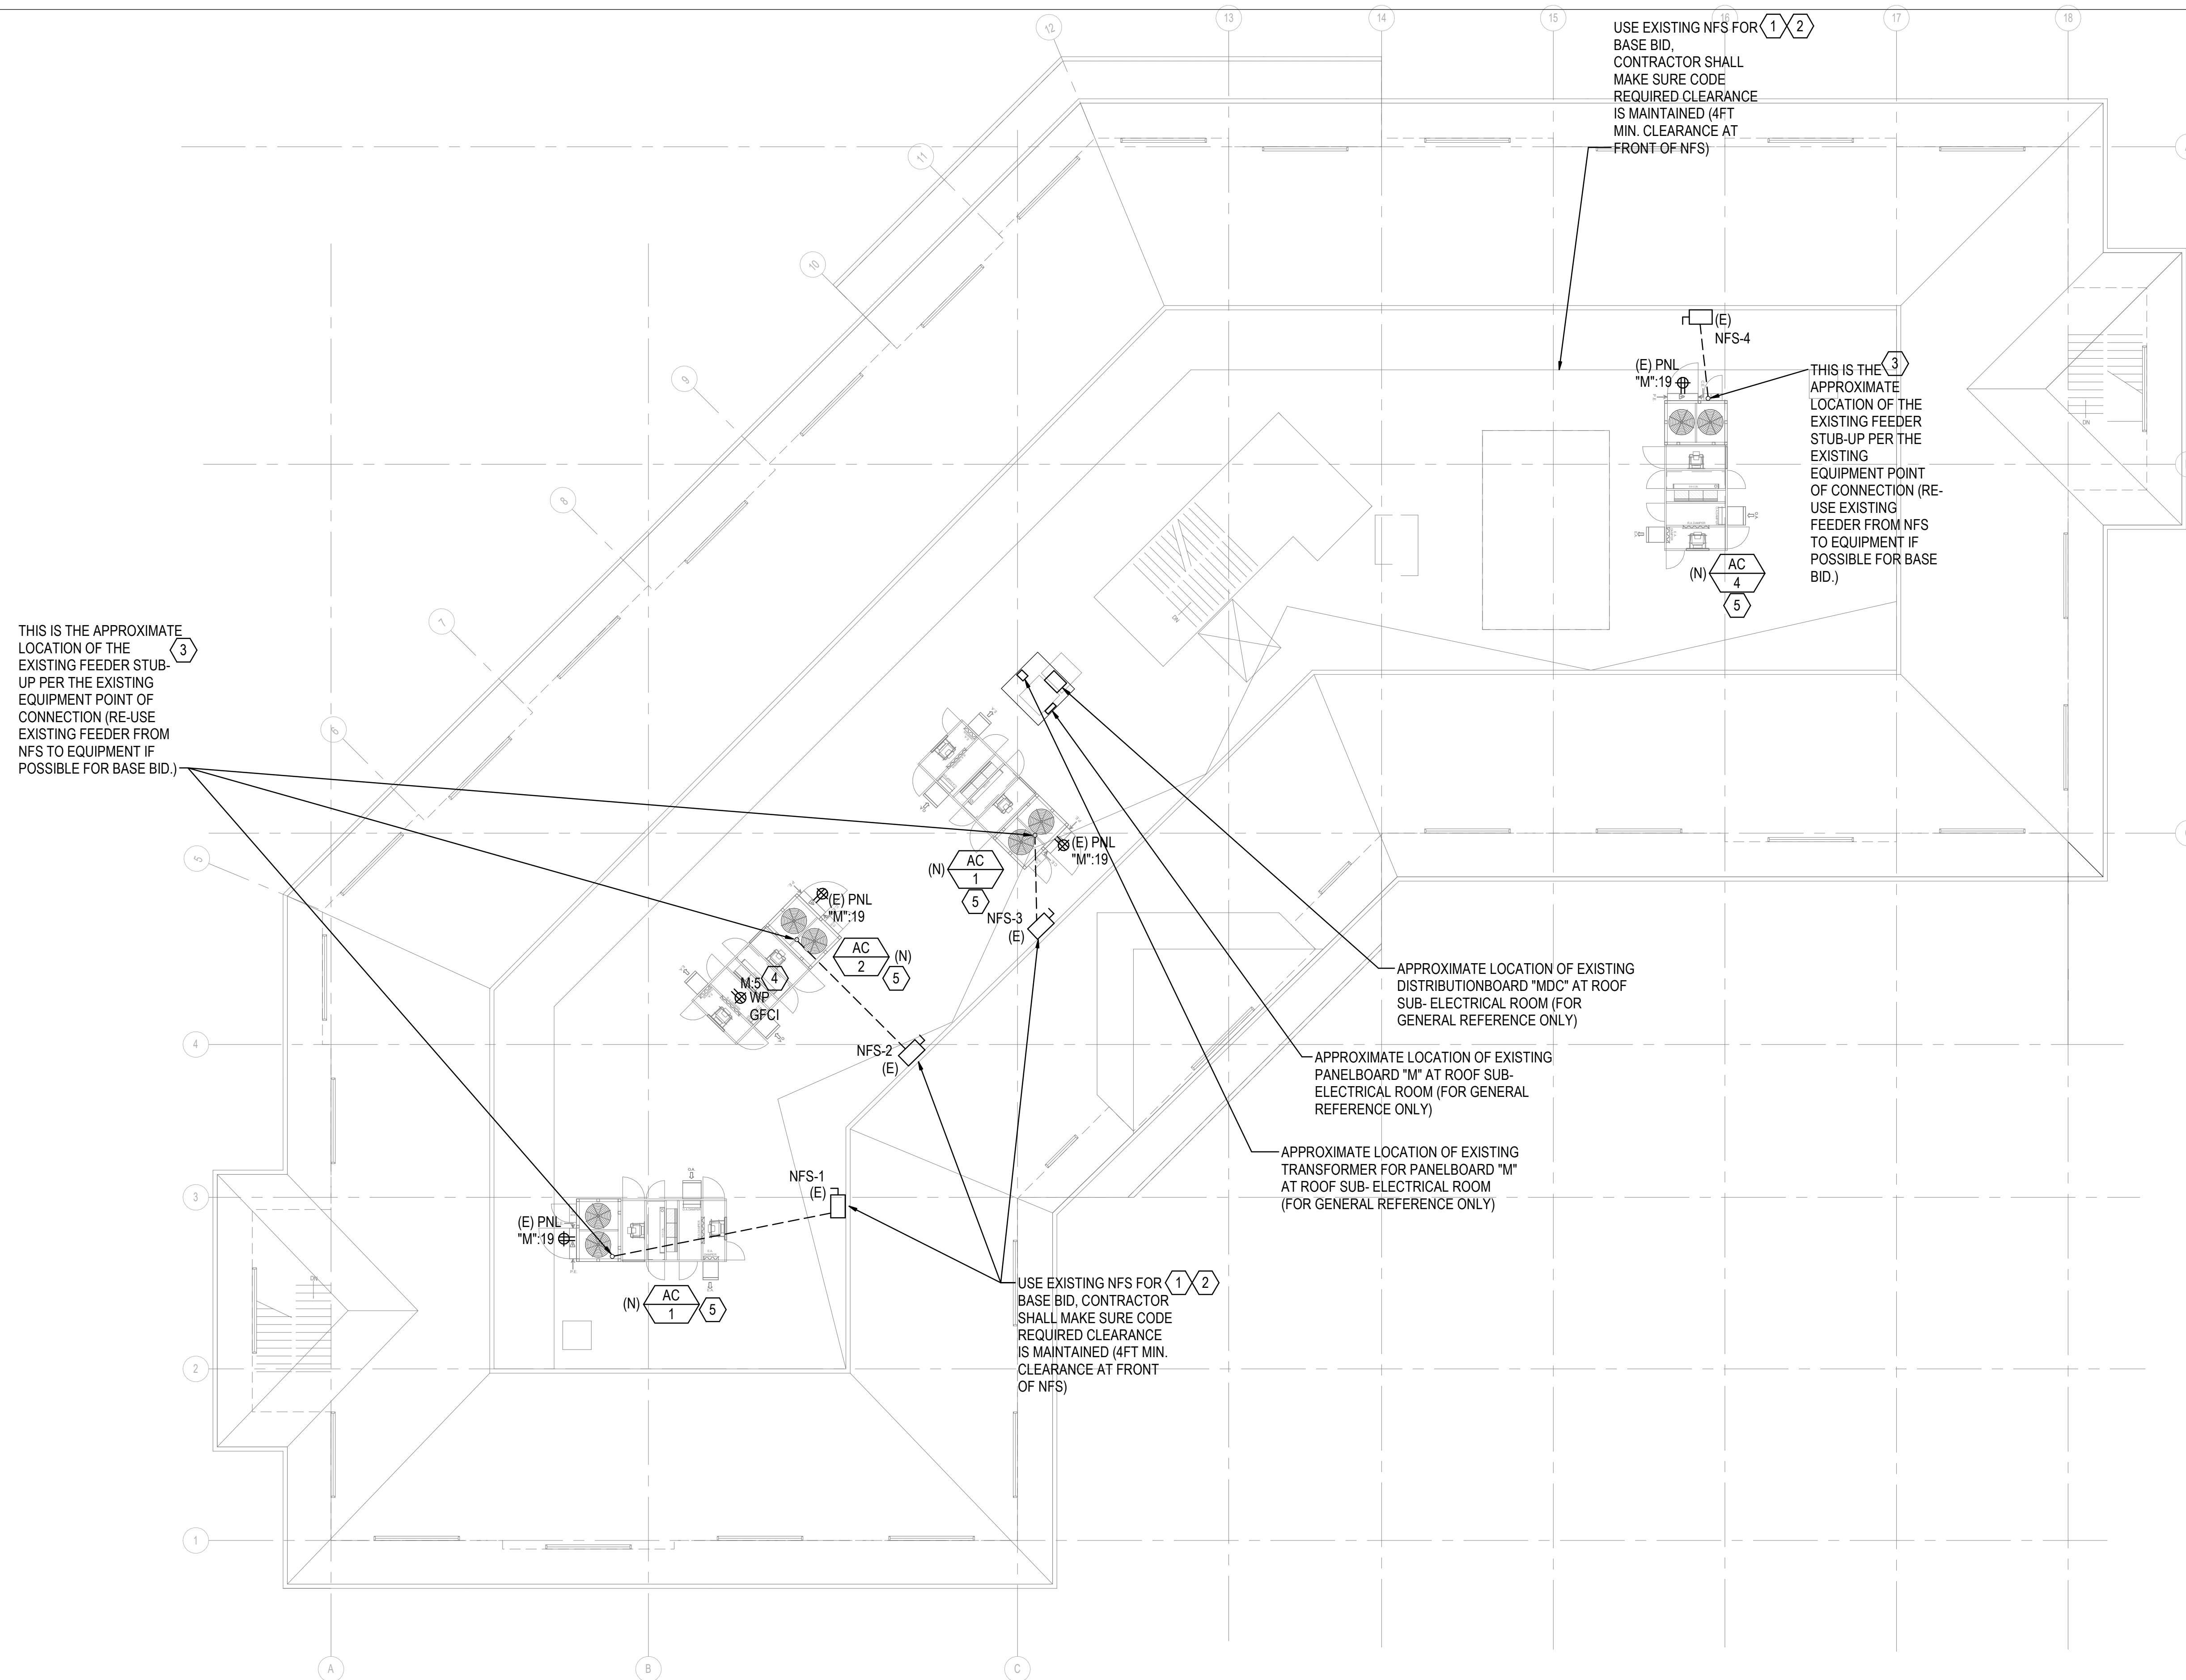

USE EXISTING NFS FOR (1) (2)
BASE BID,
CONTRACTOR SHALL
MAKE SURE CODE
REQUIRED CLEARANCE
IS MAINTAINED (4FT
MIN. CLEARANCE AT
FRONT OF NFS)

APPROXIMATE LOCATION OF EXISTING
DISTRIBUTIONBOARD "MDC" AT ROOF
SUB- ELECTRICAL ROOM (FOR
GENERAL REFERENCE ONLY)

USE EXISTING NFS FOR
BASE BID, CONTRACTOR
SHALL MAKE SURE CODE
REQUIRED CLEARANCE
IS MAINTAINED (4FT MIN.
CLEARANCE AT FRONT
OF NFS)

1 ELECTRICAL ROOF POWER PLAN

SHEET NOTES